

# DRIFTSRAPPORT

Månedsrapport Marts 2020

Faurbo Vandværk

1/2



## MÆNGDER

TOTAL INDVUNDET	2009,46 m <sup>3</sup>
Boring 1	948,56 m <sup>3</sup>
Boring 2	1060,90 m <sup>3</sup>
TOTAL UDPUMPET	1983,76 m <sup>3</sup>
Udpumpning	1983,76 m <sup>3</sup>
TOTAL SKYLLEVAND	0,00 m <sup>3</sup>
Skyllevand	0,00 m <sup>3</sup>

## ELFORBRUG




ELFORBRUG	
Samlet proces	2277 kWh
Delproces / udpumpning	867 kWh



## NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

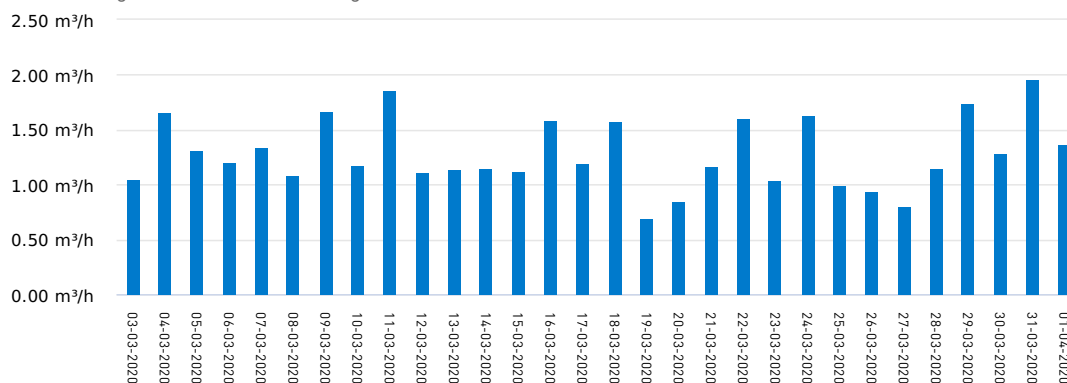

## FILTRE

Filter 1	5 skyl
Filter 2	5 skyl
Filter 3	7 skyl
Filter 4	7 skyl

## DRIFTTIMER



BORINGER	
1	112 timer
2	130 timer
PUMPER	
1	380 timer
2	363 timer
FILTERMOTOR	
1	242 timer
2	1 timer



Blue Control®  
BC7000

# DRIFTSRAPPORT

Månedsrapport Marts 2020

Faurbo Vandværk


2/2



## NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-48,39 m	-52,94 m	4,55 m	948,56 m <sup>3</sup>
2	-48,59 m	-53,14 m	4,55 m	1060,90 m <sup>3</sup>

Fordeling for indvundet vand

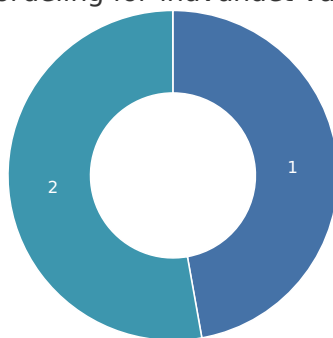

● Boring 1 : 47.2%  
● Boring 2 : 52.8%



Blue Control®  
BC7000